

# Thirsty Data

Margaret Cook, PhD




HARC

# Houston Advanced Research Center


HARC applies science to drive energy, air, water, and resilience solutions for a sustainable and equitable future. HARC applies science to drive energy, air, water, and resilience solutions for a sustainable and equitable future.



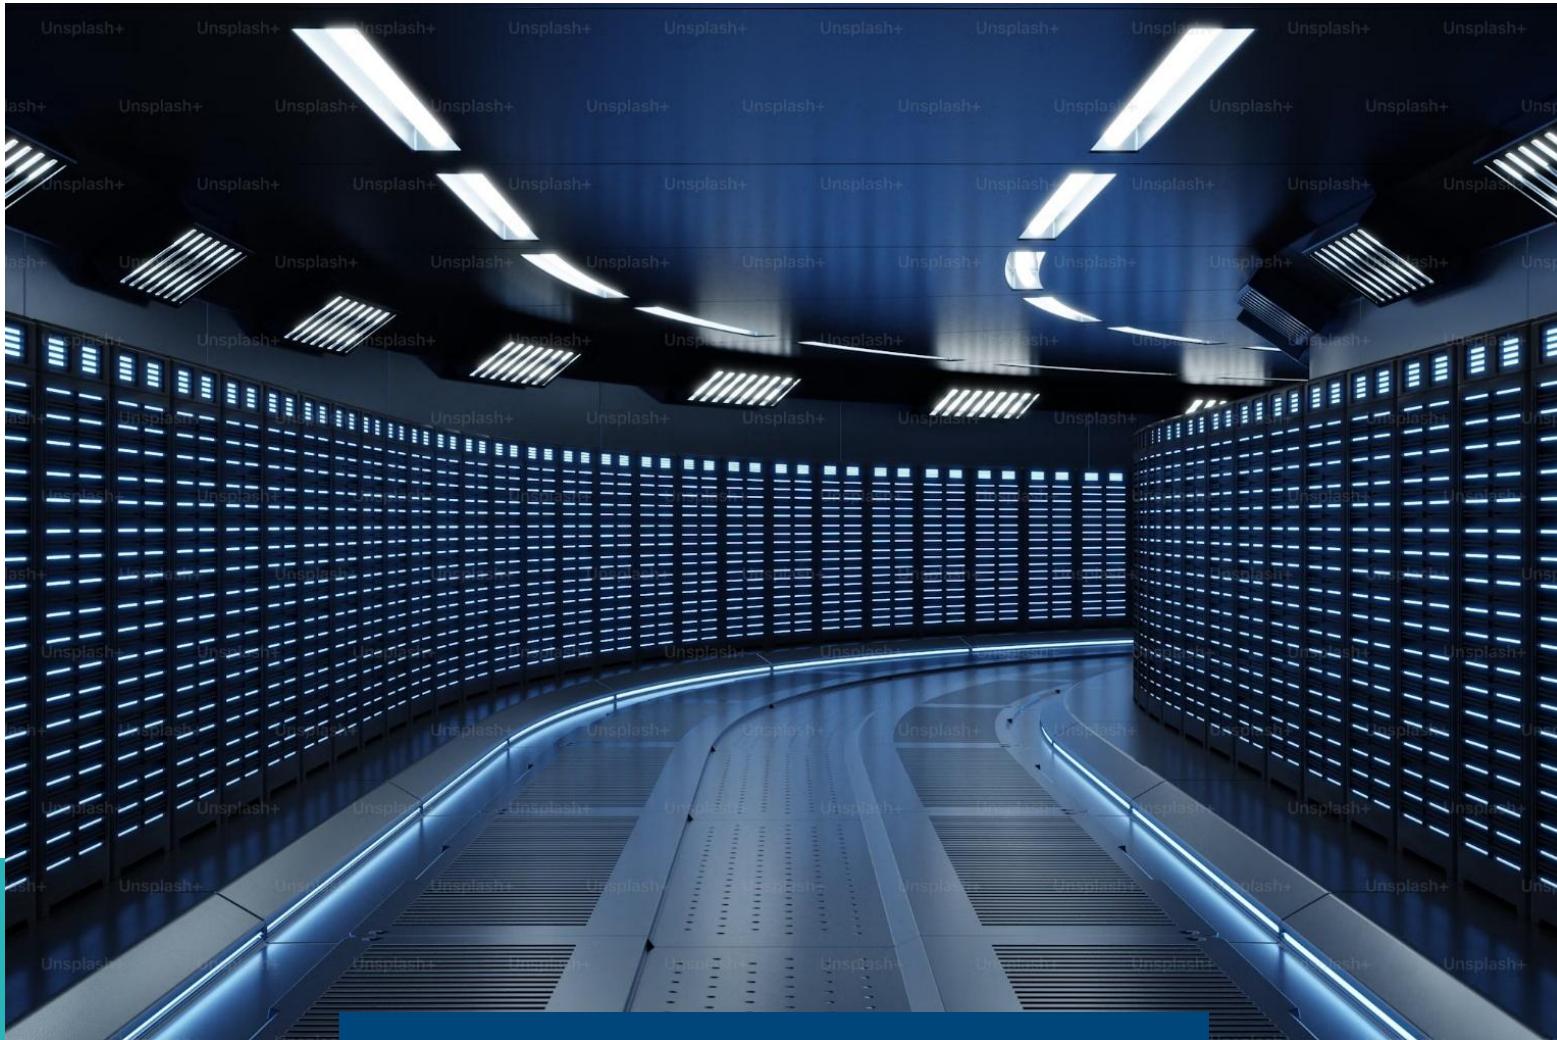


Data centers house computing  
infrastructure

# Data Center Infrastructure in the United States, 2025

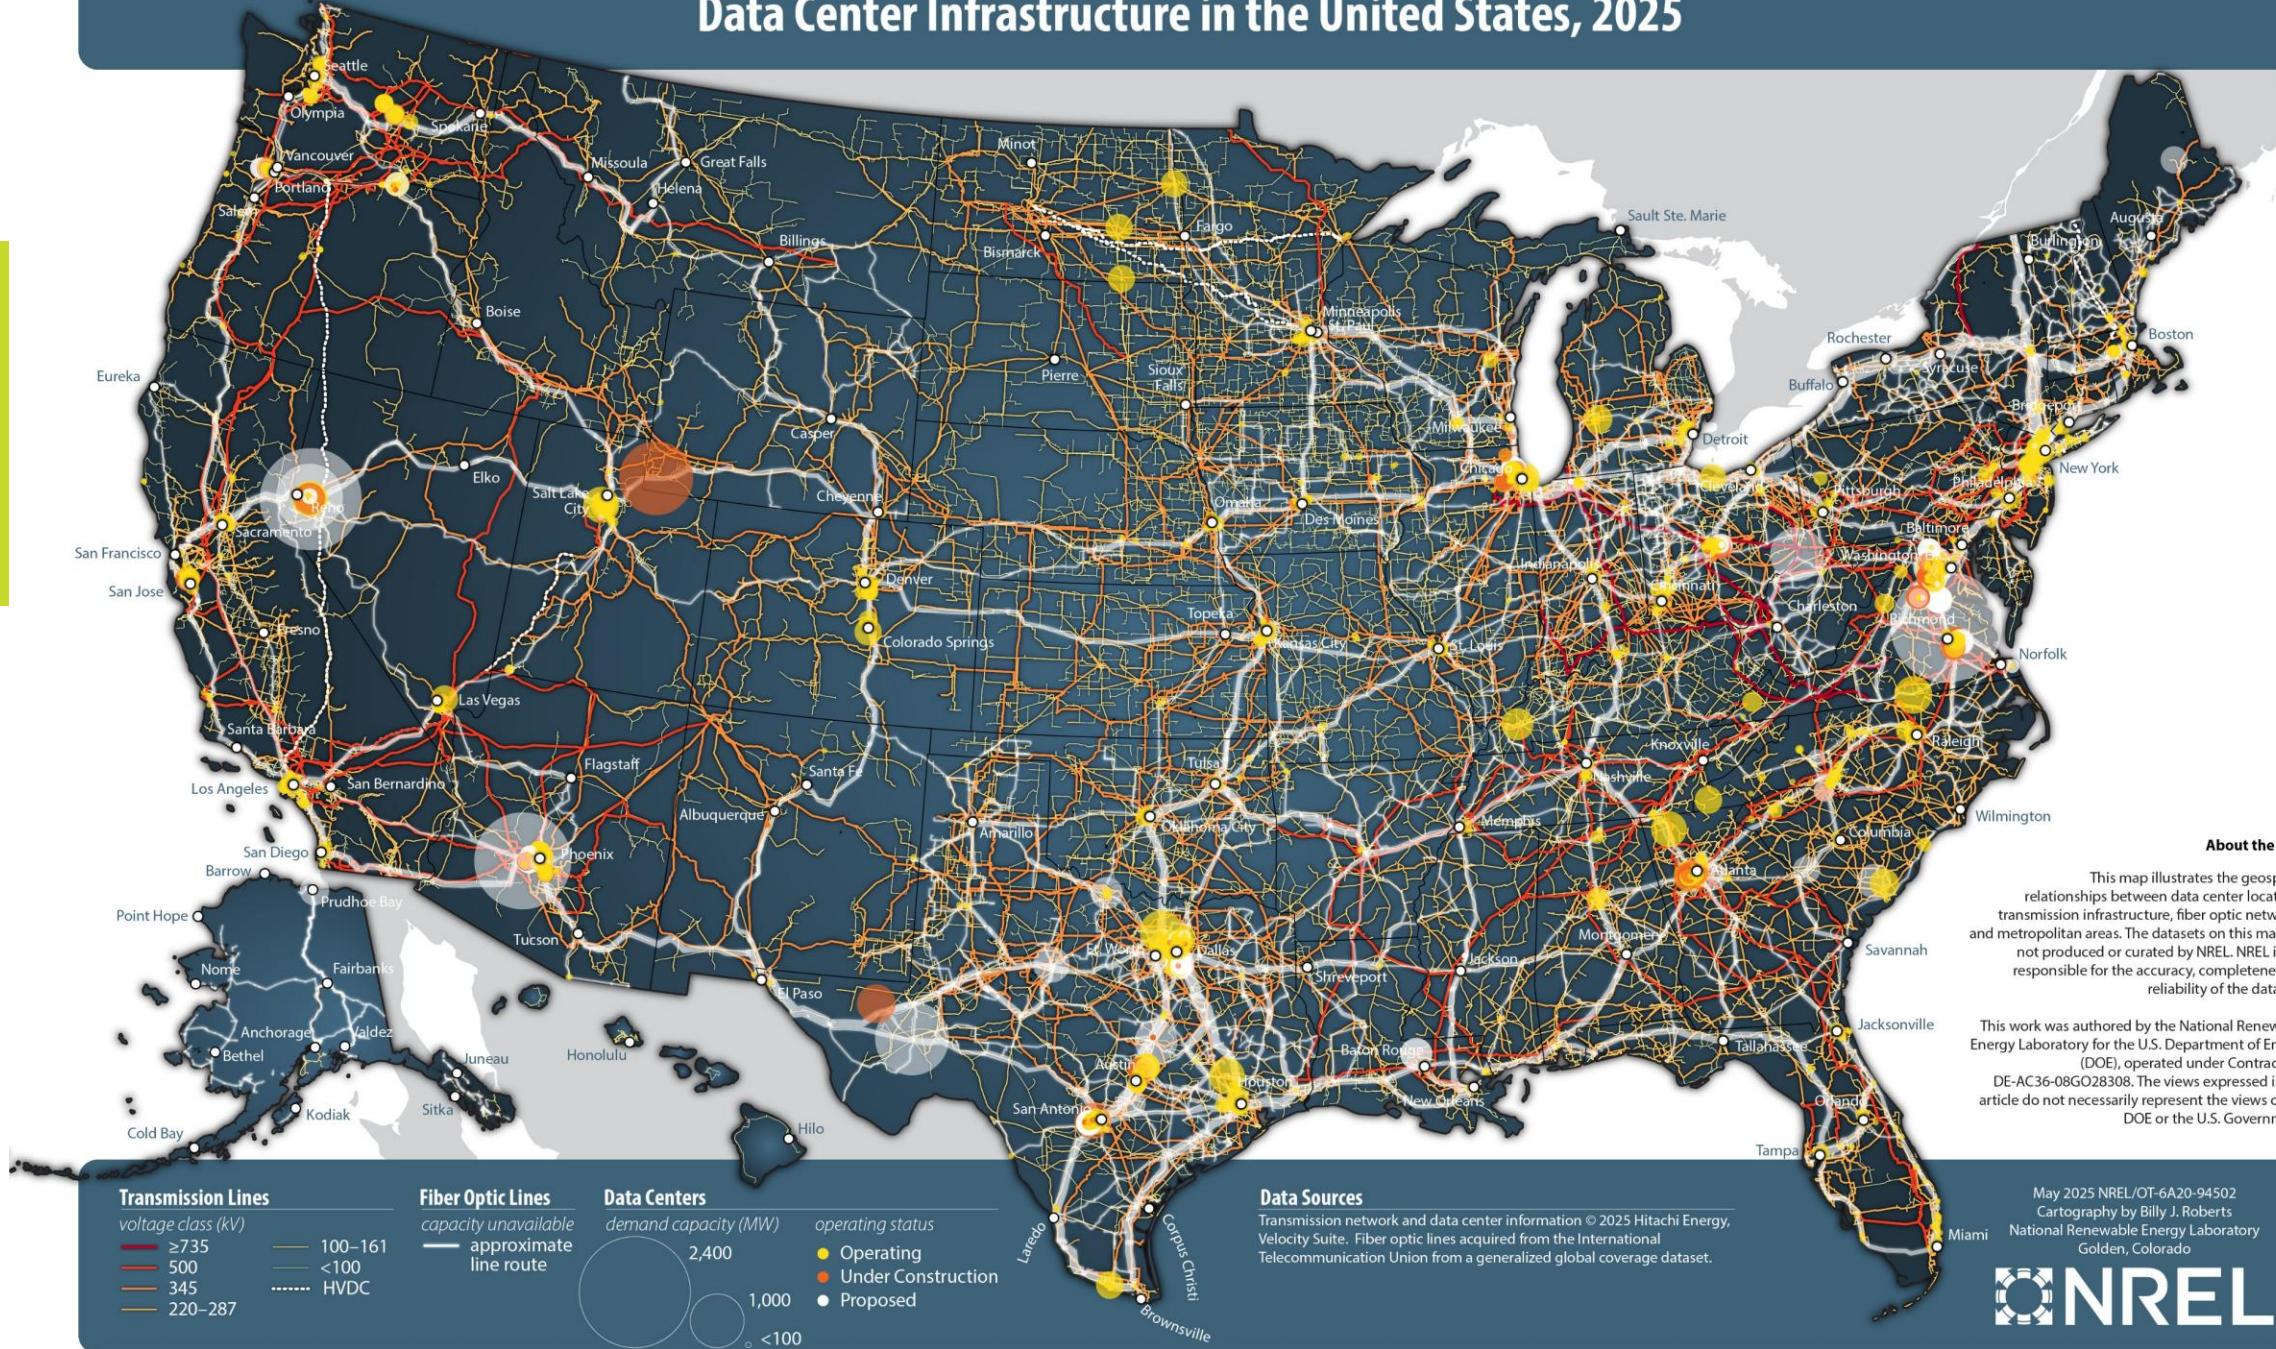

# Siting Decisions

- Land lease
- Power price
- Adjacent to fiber
- Floodplain and other building considerations
- Ability to source water (if needed)
- Proximity to labor force
- Distance from residential and other permitting considerations

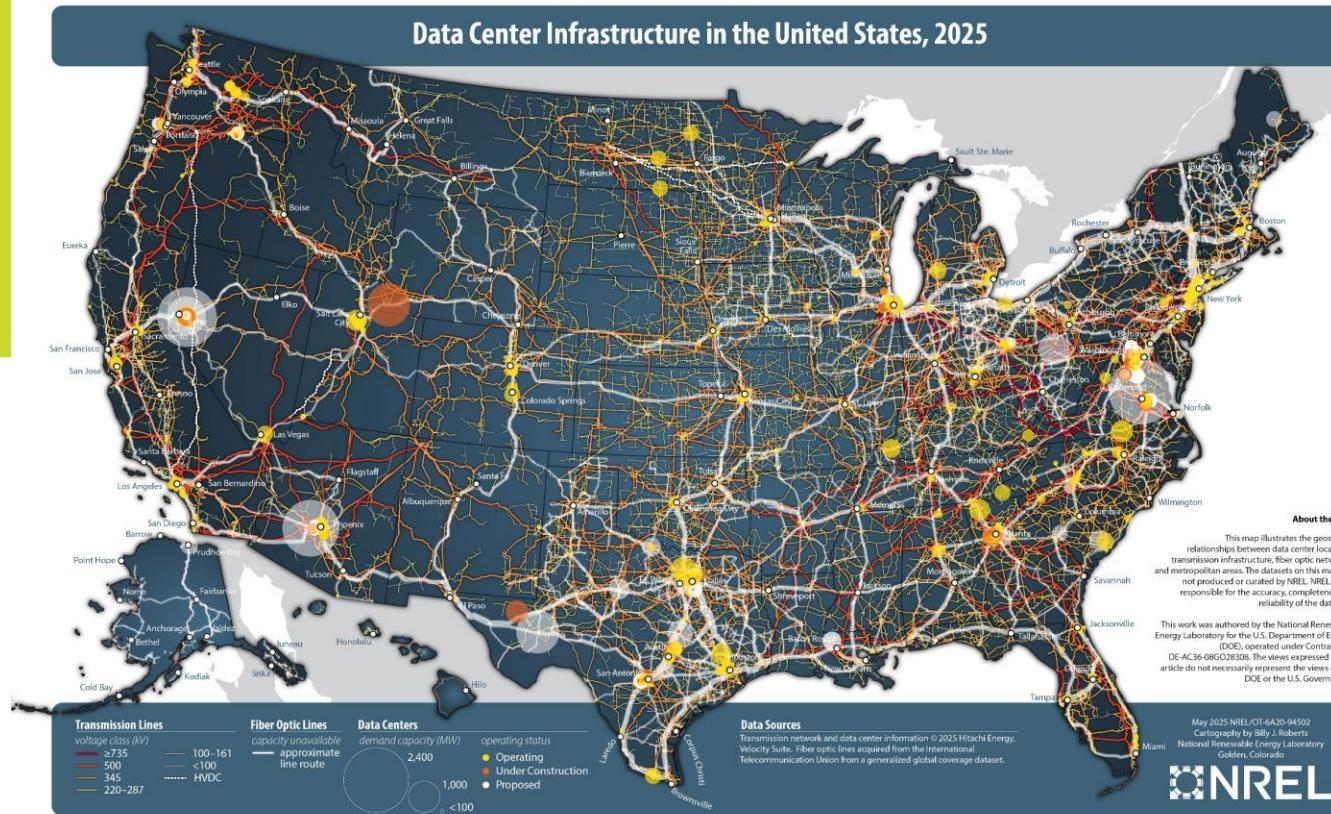

# Estimated Water Demands

- **Est. water demand:** average ~95 gals/MWh [LBNL 2024]
- **Direct water use:** evaporation through a chiller or cooling tower
  - new withdrawals occur to replace vaporized water with freshwater, recirculates
- **Wastewater:** largely blowdown – water removed from cooling supply to prevent excessive concentration of dissolved solids (it gets too briny)
- **Indirect water use:** at power plants for cooling
- **Individually:** water demand may not be large
  - **Collectively:** Rapid growth rate, large localized presence and impacts

# Factors Influencing Water Use

Amount of water use depends on

- Cooling type used (right)
- The size of the data center, and
- The type of data center (hyperscaler, crypto, etc.)
- The computing equipment needing cooling



## Cold Plate Cooling

Cooling hottest components in non-immersed loop



## Dry Cooling

Heat transferred through cool air. Higher energy demand. Not possible for all data center types.



## One-Phase Cooling


Servers immersed in oil-based liquid. Heat exchanged to liquid then water. Hot water sent to cooling tower (evaporates).




## Two-Phase Cooling

Servers immersed in chemical liquid. Heat causes liquid phase change. Heat exchanged with water.


# One-Phase Immersion Cooling

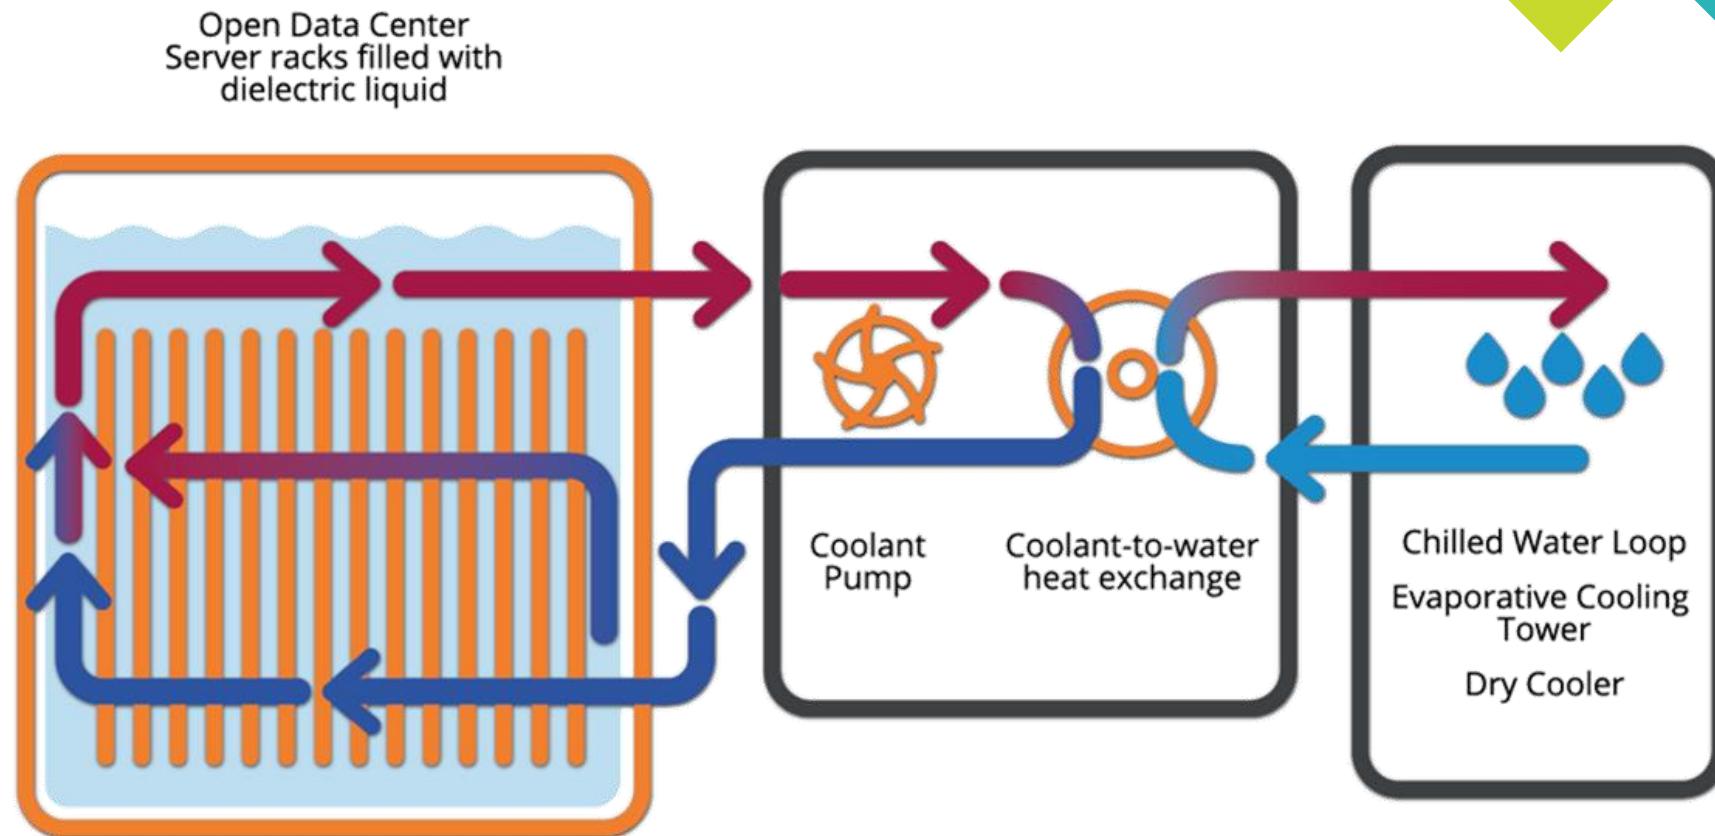


# One-Phase Immersion Cooling

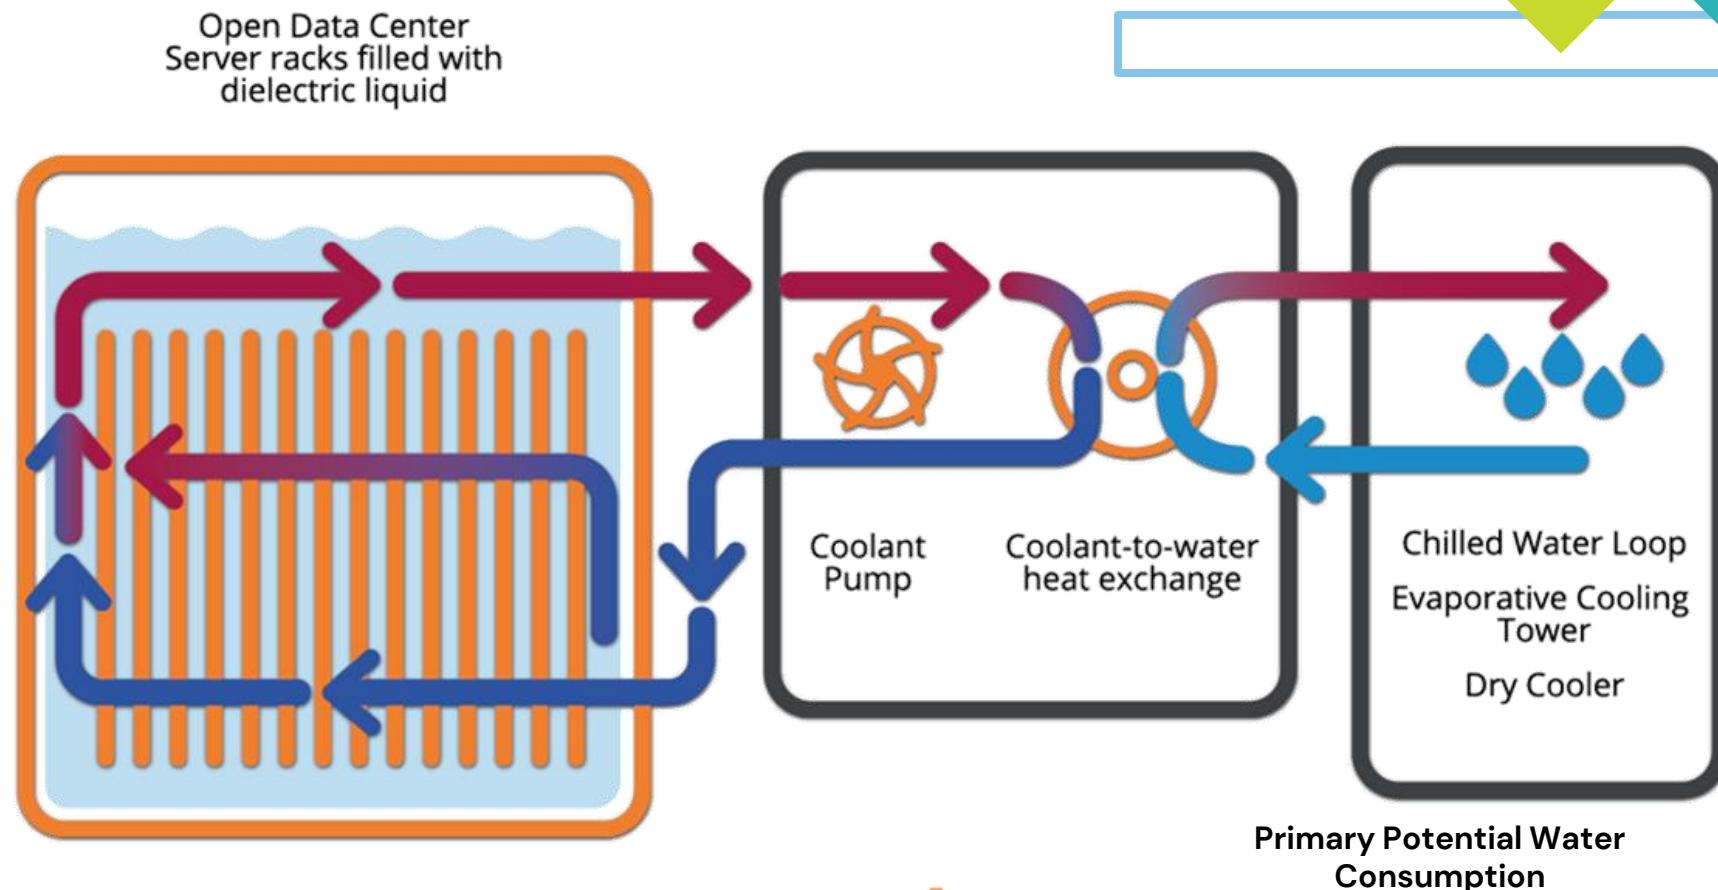


# Two-Phase Immersion Cooling

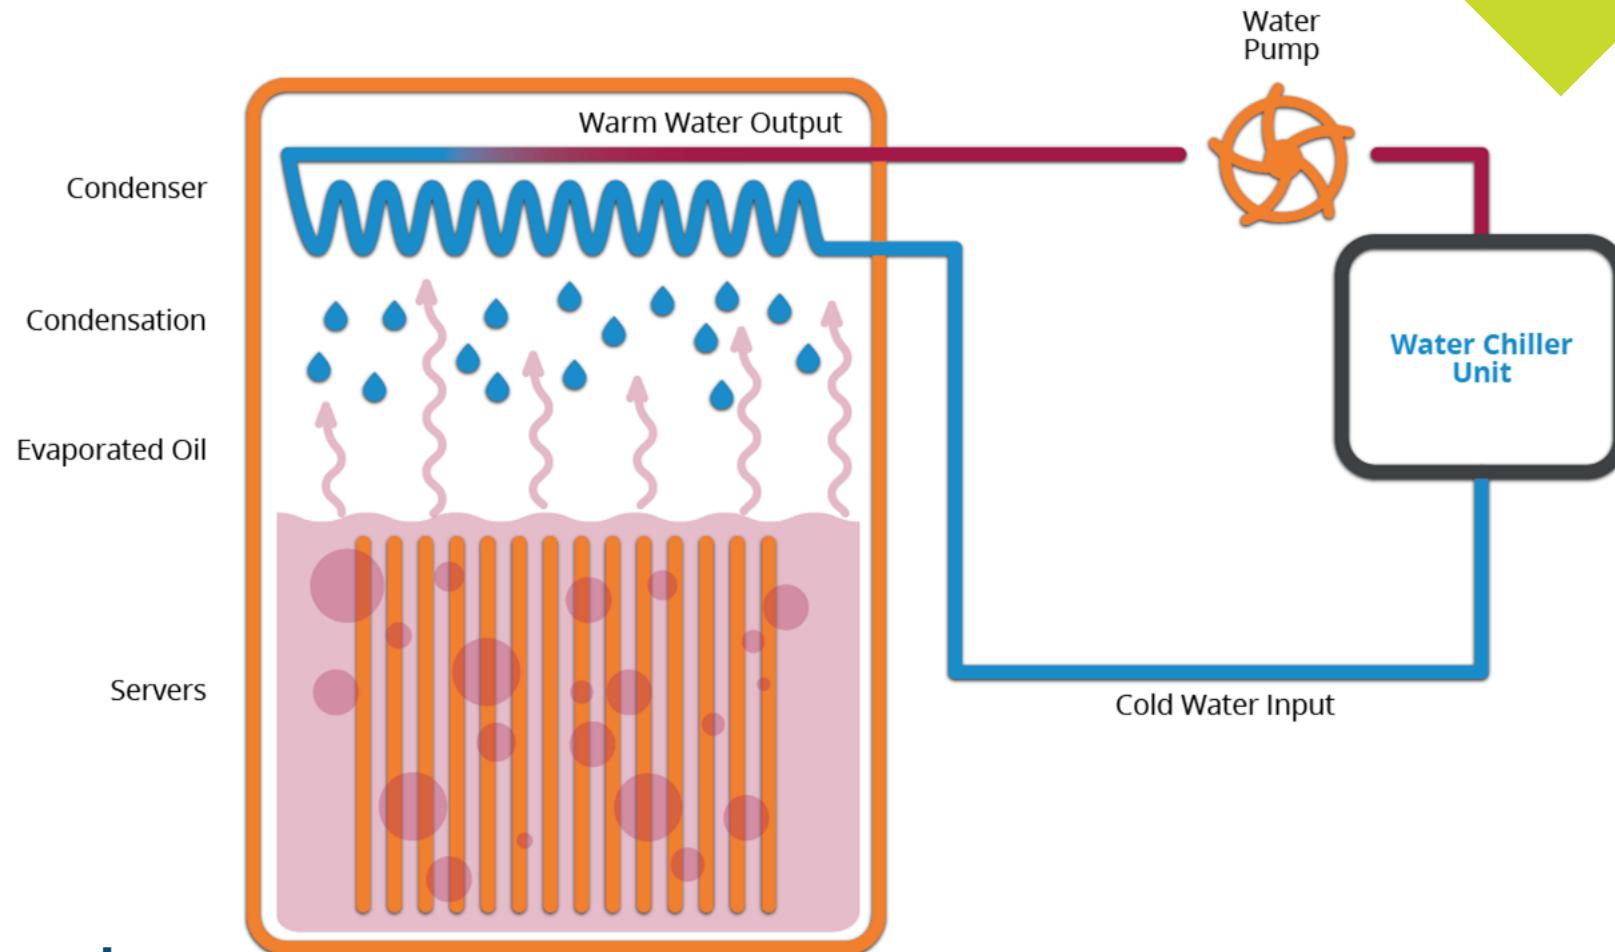


# Two-Phase Immersion Cooling

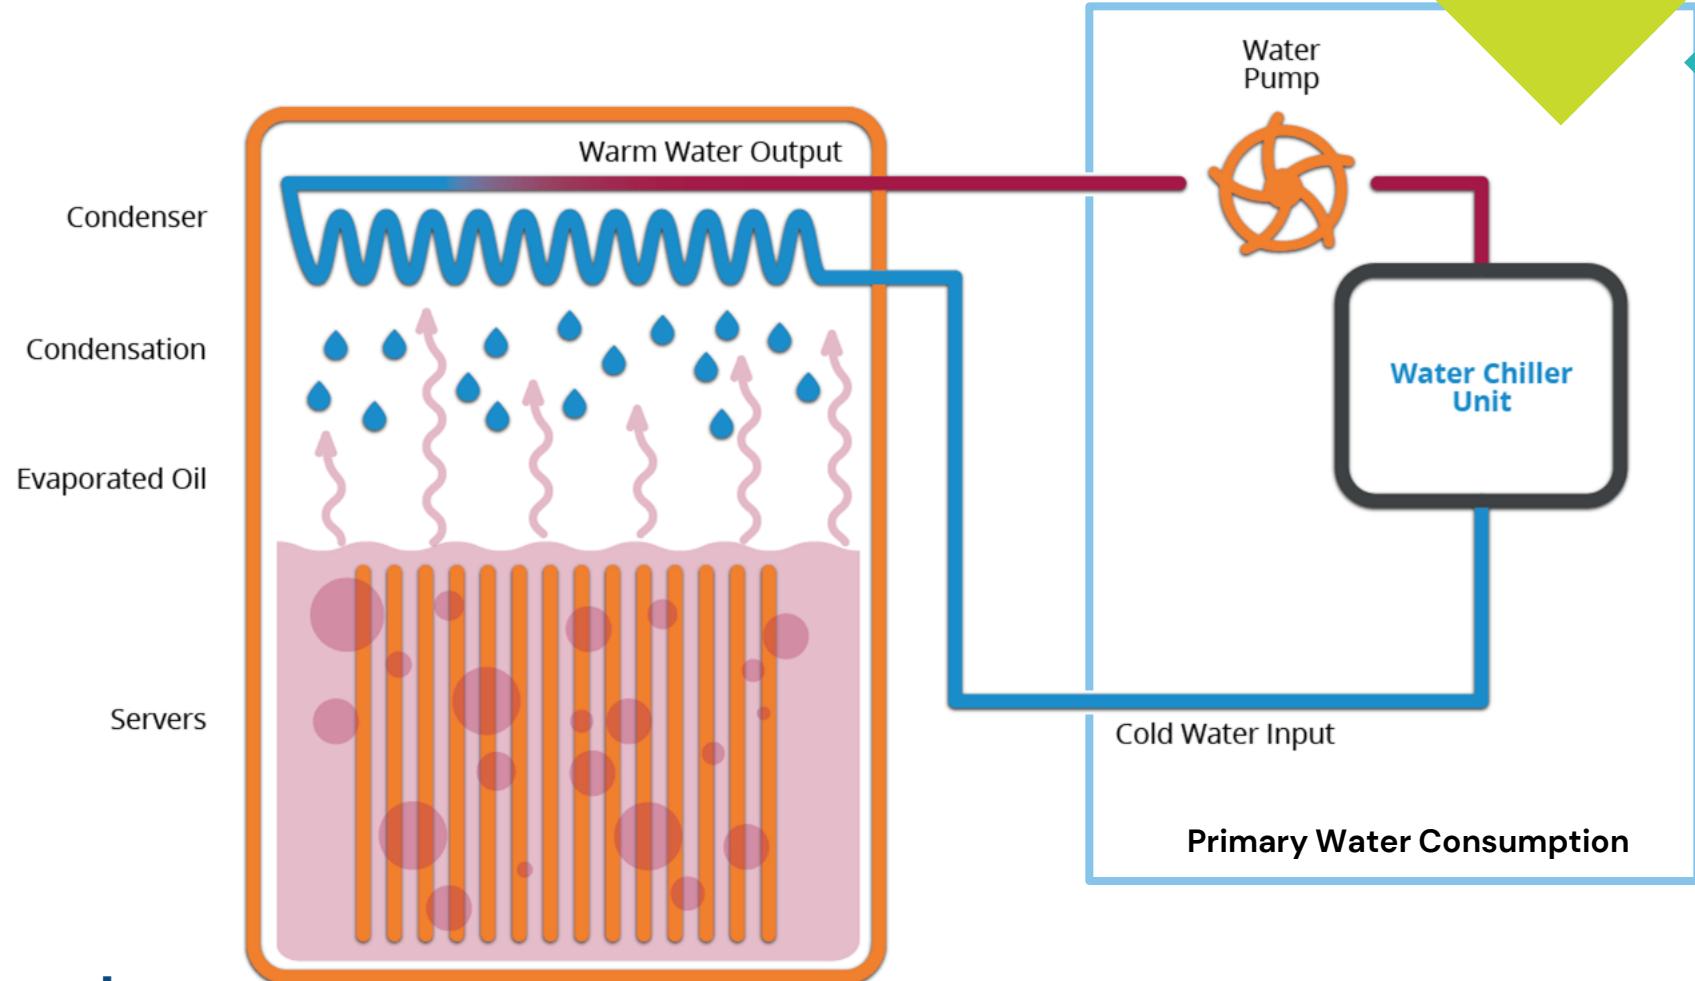


# Direct / Cold Plate Cooling

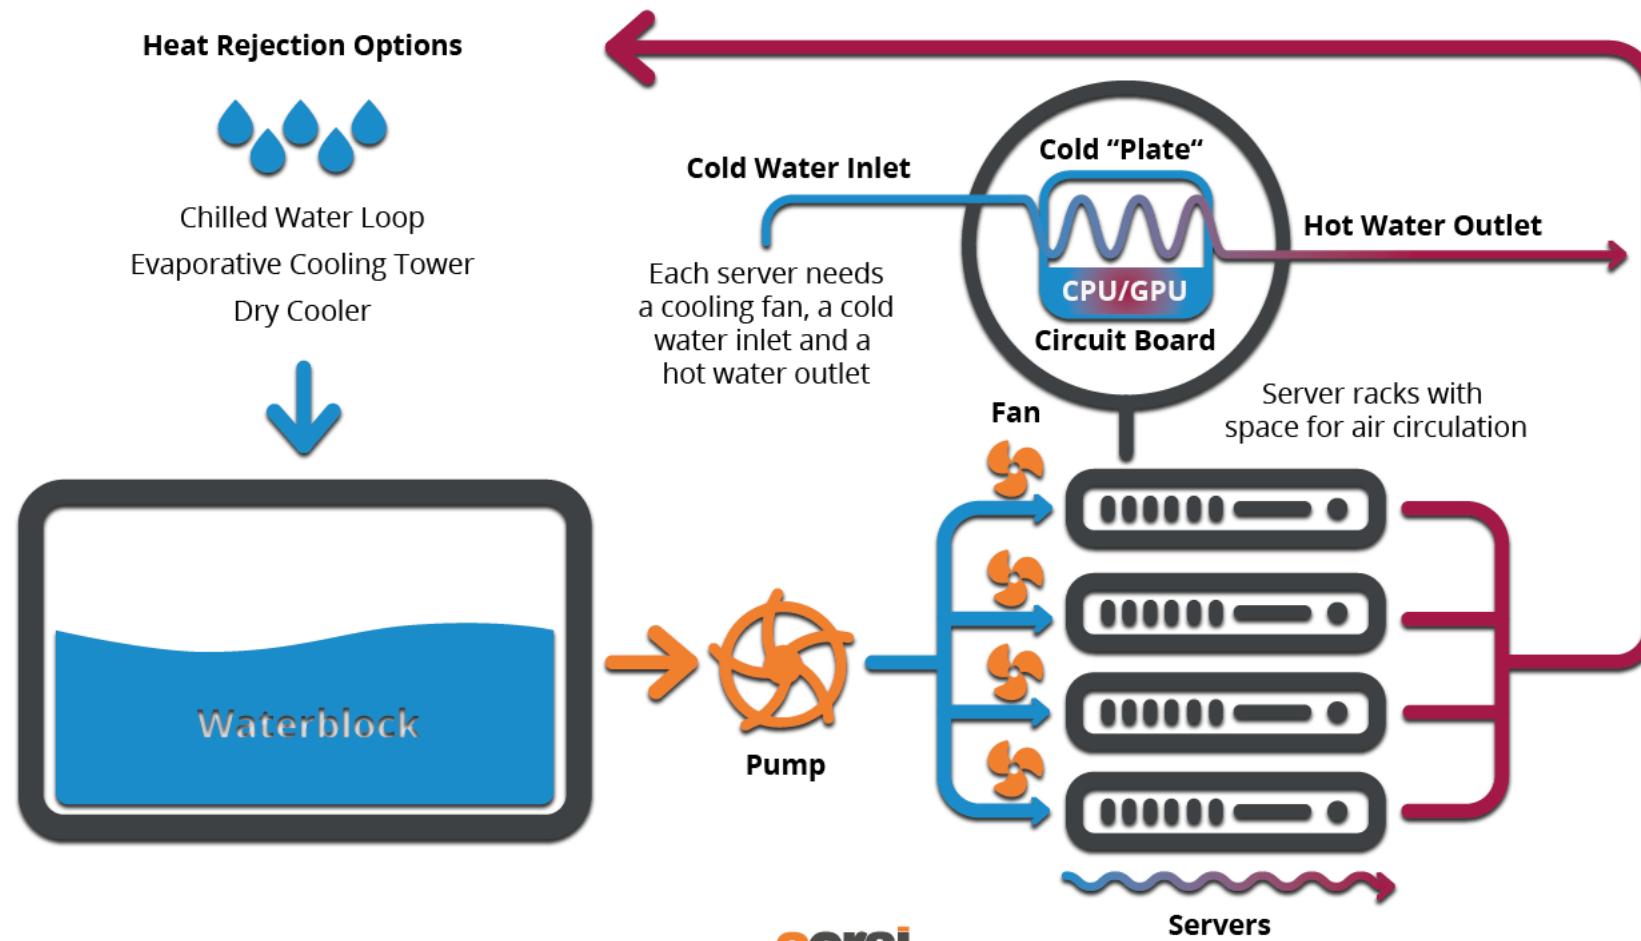

# Direct / Cold Plate Cooling

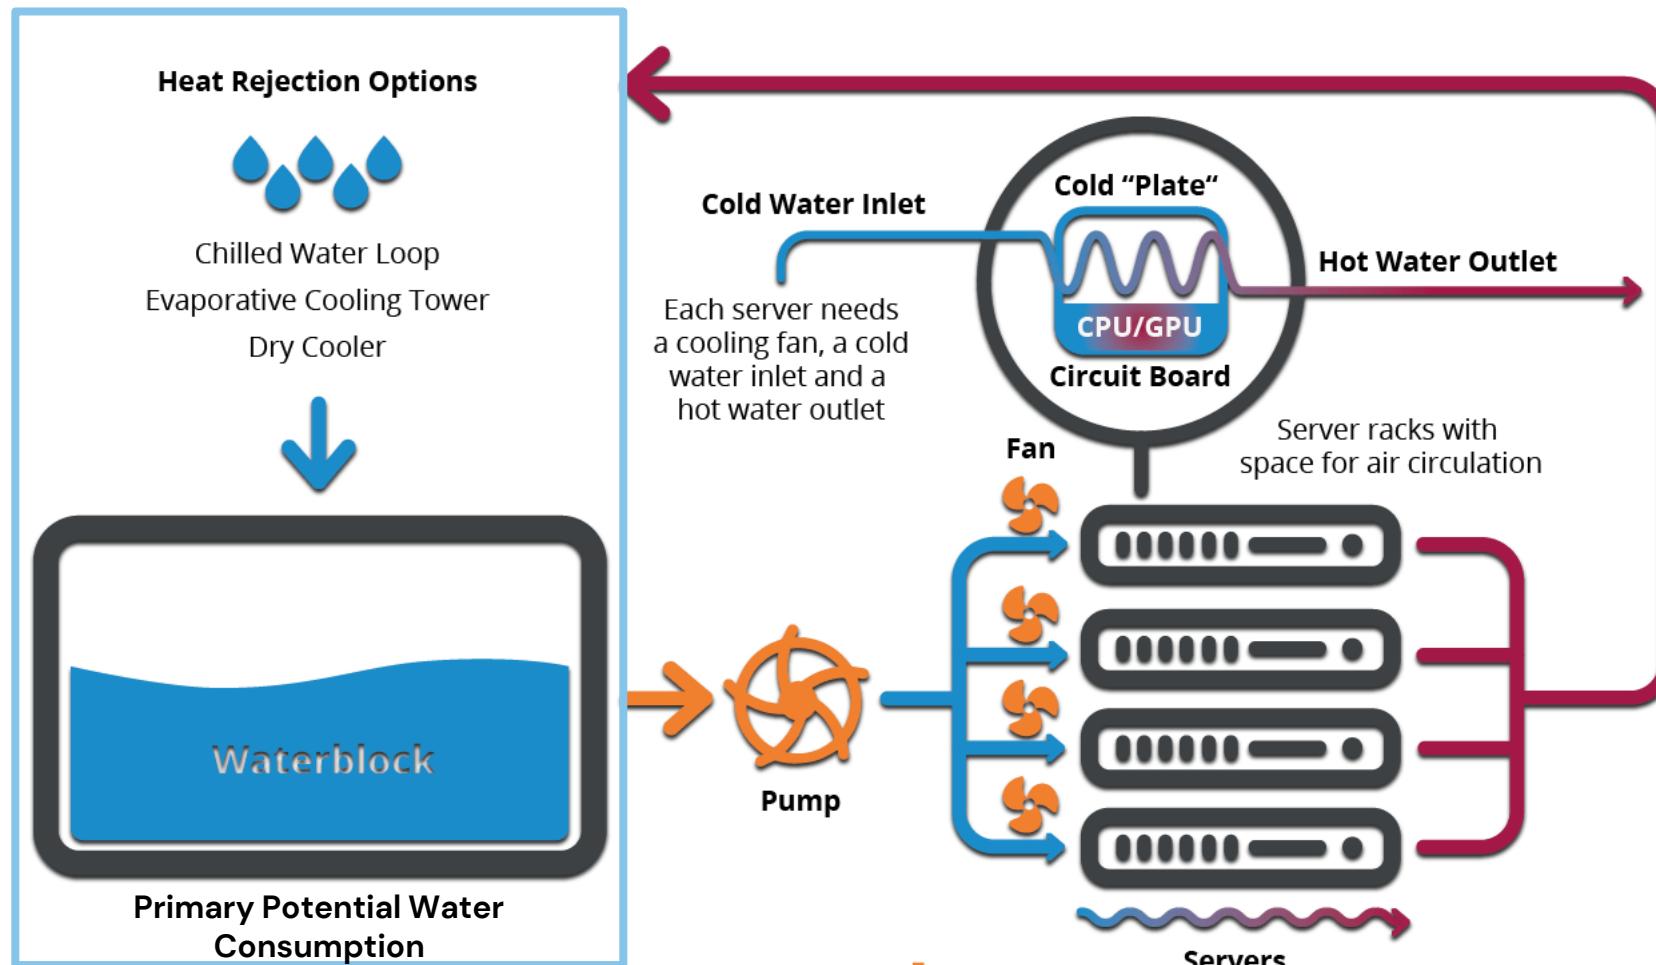


# Air Cooling / Dry Cooling

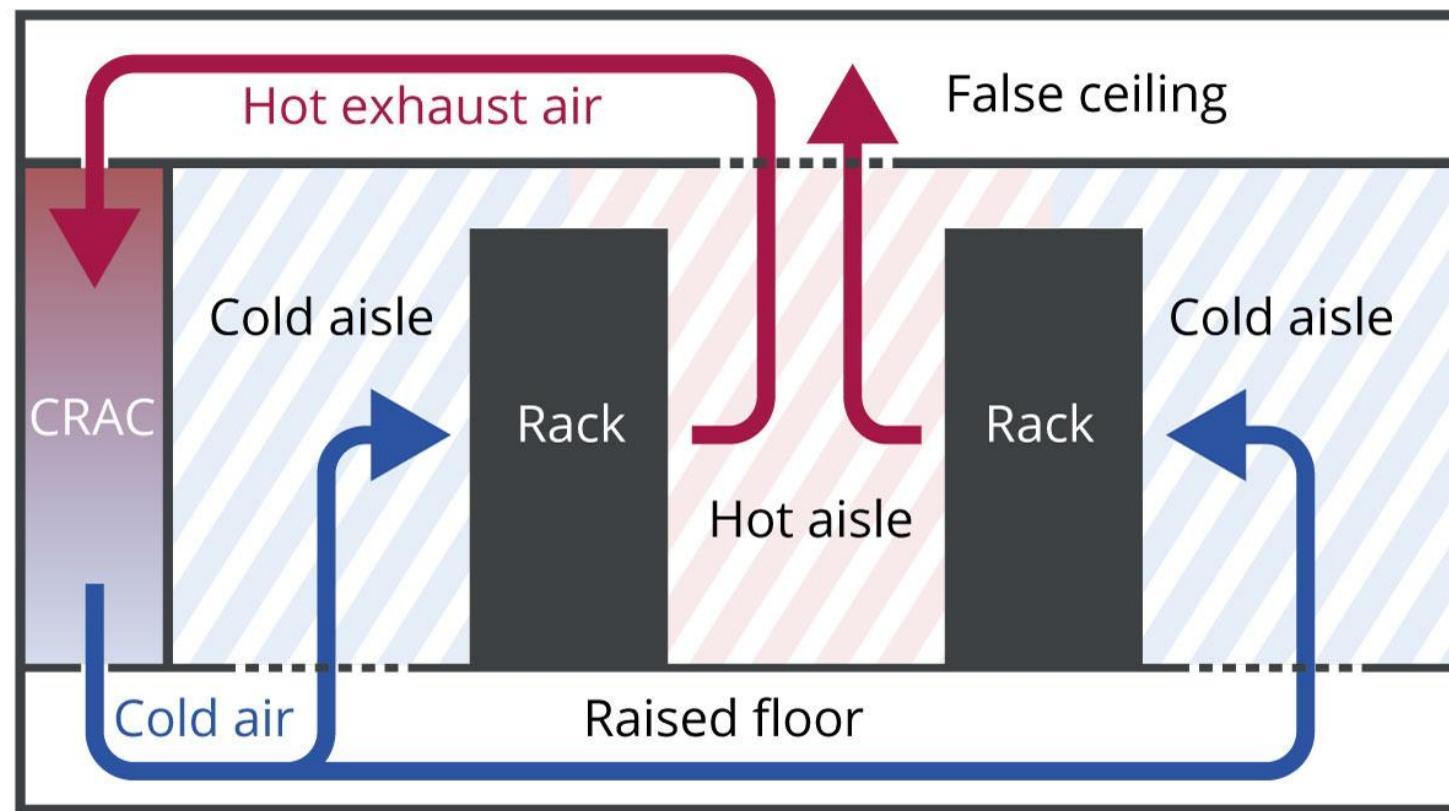

# Texas Data Centers

As of September 2025, Texas had 464 facilities (according to Baxtel):

- 197 in Dallas Fort Worth (3<sup>rd</sup> largest market in US)
- 48 in Houston (12<sup>th</sup> largest market)
- 60 in San Antonio
- 53 in Austin
- 59 in West Texas
- more sites under construction and more in planning and development

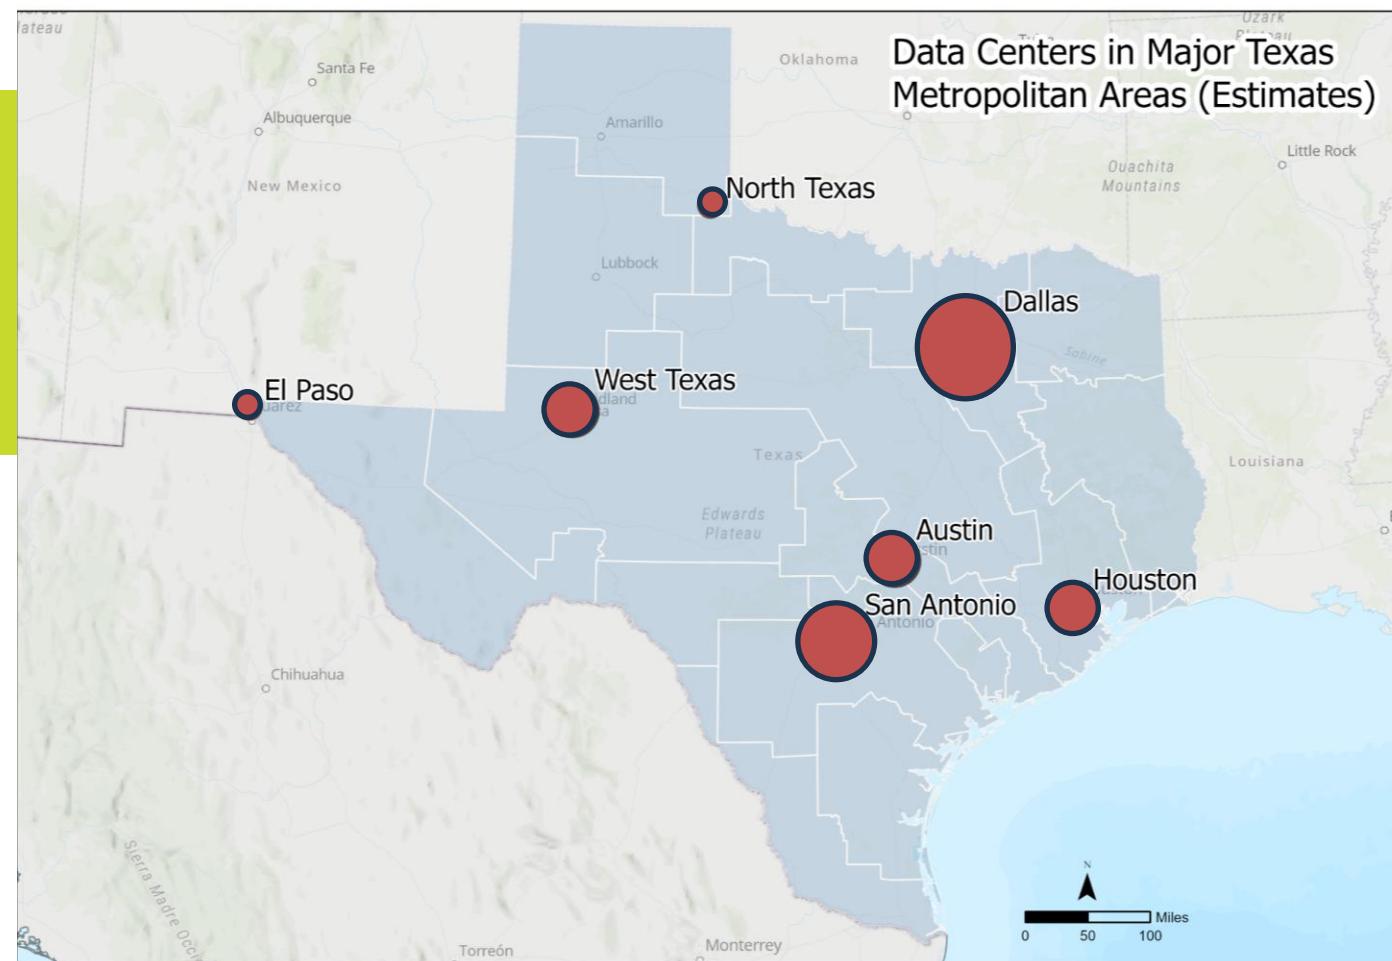

Information on data centers obtained from the Baxtel website. The North Texas location represents an approximate grouping of data centers near Wichita Falls, Pampa, & Dumas. The West Texas location represents an approximate group of data centers between Amarillo, Pecos, Abilene, & Fort Stockton.

# Data Center Energy Demands

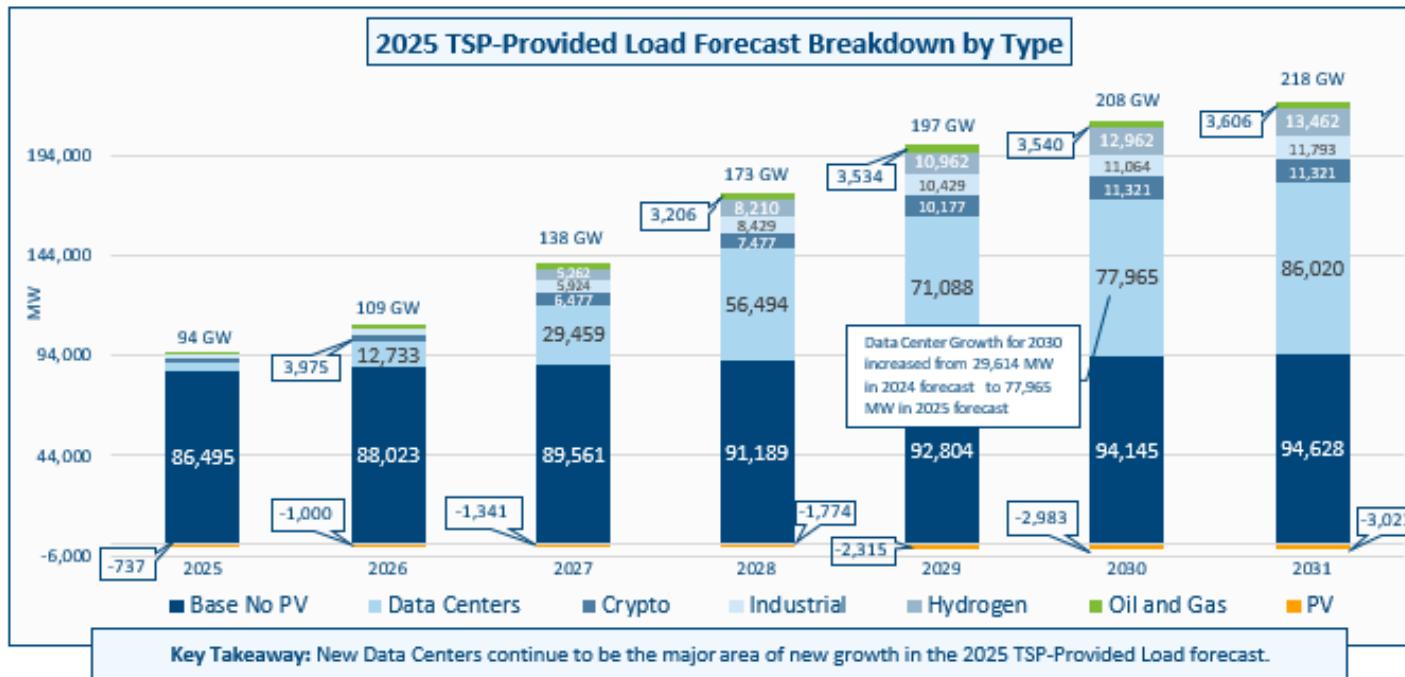


Figure 1 Long-term Load Forecast for 2025-2031 provided by ERCOT on April 7, 2025 shows data centers contributing to major electricity sector demand growth.<sup>13</sup>

\*PV is “behind the meter” rooftop photovoltaic solar—solar providing power to a home or business rather than to the grid

Sept. 2025: 9,567 MW

By 2030, ERCOT expects DC growth to increase ~2-10x  
If running at full-steam

Data Centers historically have high water needs for cooling

- Direct at the data center
- Indirect at power plants

# Estimated Water Demands

- 2025 estimated total consumption
  - 34 Bgal water/year for cooling (direct) and 15 Bgal at power plants (indirect)
  - 0.8% of 2020 estimated annual water demand (2022 State Water Plan)
- By 2030
  - Up to 78 GW power consumption – some grid, some onsite
  - Data centers could account for 29-161 Bgal (98-494 kAF) by 2030 or 0.5-2.7% of 2030 estimated annual water demand (2022 SWP)
    - *Localized demands, large local impacts*

# Case Study on Stargate, Abilene, TX

- 1.2 GW hyperscaler w/ natural gas turbines
- Cooling: Closed-loop direct-to-chip (DTC) liquid cooling system recirculates water internally with **water-cooled chillers** to get rid of heat
  - Water-cooled chillers: 4.9-7.6 Bgal/year
  - Hybrid water/air chillers: 0.6-1.3 Bgal/year



OpenAI Stargate facility in Abilene, TX (Data Center Dynamics)

# Challenges of Estimating Water Demands of Data Centers

- Data uncertainty
  - Lack of transparency from data centers
  - Few published studies available
- Data center water *growth* is not in our current or upcoming state water plan
- Municipalities don't have the most up-to-date data to make informed choices
  - Borrowing against future water needs

# Reducing Water Demands

- Technology or management changes (right)
- Leverage investment
- Public-private partnerships
- Possible policy drivers:
  - Incentives for water lean strategies
  - Water saving ordinances
  - Look to the energy sector re large demands – fees and studies required
- One Water framing



## Water-Lean Technology

Use water-lean energy technologies like solar, wind, and natural gas turbines; reduce water on-site



## Dry Cooling

Use dry cooling at data centers and power plants (energy penalty – use w/ water-lean energy)




## Alternative Water

Use alternative sources of water like municipal reuse & onsite grey water



## Reduce Energy On-site

Energy-efficient operations and scheduling non-peak demand periods

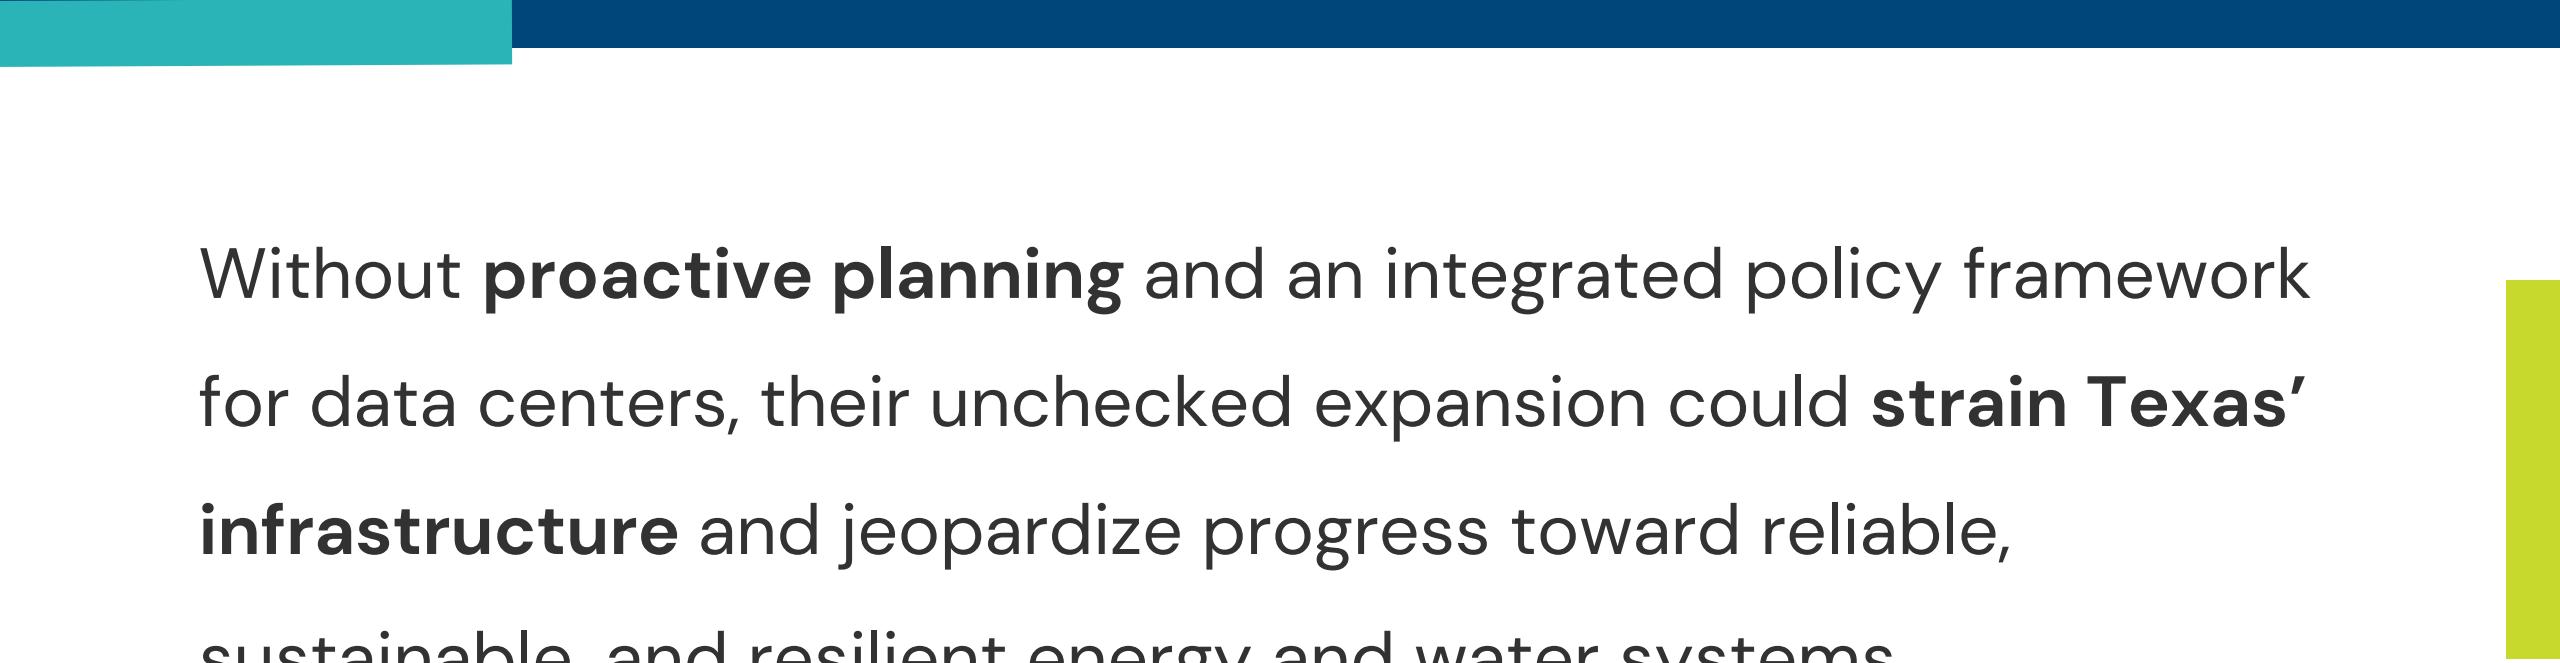

Without **proactive planning** and an integrated policy framework for data centers, their unchecked expansion could **strain Texas' infrastructure** and jeopardize progress toward reliable, sustainable, and resilient energy and water systems

# CONTACT US

For further information, contact HARC at  
(281) 364-6000 or visit [www.HARCresearch.org](http://www.HARCresearch.org).

Connect with HARC via [Instagram](#), [LinkedIn](#),  
[Facebook](#) or [Twitter](#). Like or follow @HARCresearch.

